

### ENGINEERING SPECIFICATION

### 工程規格書

客戶 / CUSTOMER	:	
產品名稱 / ITEM	:	带线人体感应控制开关 PIR SENSOR SWITCH
顏色/Colour	:	<b>Black</b>
客戶編號 / CUSTOMER P/N	:	
擎洲样品申请单号/Samples request No	:	
擎洲产品型號 / OUR MODEL NO.	:	<b>HEK0000233</b>
標準 / STANDARD	:	
額定 / RATING	:	<b>Input:DC12/24V I<sub>max</sub>=100mA</b>
	:	<b>Output: DC12/24V I<sub>max</sub>=100mA</b>
備注 / REMARKS	:	<b>RoHS STANDARD</b>

根據本公司政策規定,貴司必須於該產品首次生產之前簽回我司規格書的首頁、銘牌共二頁,以確認該產品之規格。

另外,請貴司於下單時在採購單上打上本公司產品編號以及样品单编号,以避免生產錯誤。

如貴司未能如期簽回規格書,我司將無法為該產品安排生產。

為免延誤貴公司之出貨時間,請貴司通力合作。

Based on the policy of our company ,all buyers MUST return this product specification sheets along with signature And company chop. Please study very carefully and sign the page of Engineering Specification /Nameplate for product confirmation. And also, please mark our products Model No and Samples request No while the PO issue.

NOTICE: This is very important to have this specification sheets confirmed and return to us on time to avoid any mistake Or delay of delivery. Without your confirmation, Letaron Electronic would not arrange to start the production for your company.

版本 REV.	描述/DESCRIPTION	日期 DATE	制作人 PREPARED BY
00	首次發行/FIRST ISSUE	2021/11/3	肖华臣

#### 擎洲/LETARON

	制作 Prepared	检查 Checked	核准 Approved
签名 Signature	肖华臣	徐权	
日期 Date	2021.11.03	2021.1.03	

#### 客戶/CUSTOMER

確認  
Approved by

日期  
Date

(簽字或公司蓋章)  
(Signature and company stamp)

### 1. Environment(环境):


working temperature of  $0^{\circ}\text{C}\sim 45^{\circ}\text{C}$ , 10%~90%RH (without dew point);  
(工作温度  $0^{\circ}\text{C}\sim 45^{\circ}\text{C}$ , 湿度 10%~90%RH (无凝露));  
Storage temperature:  $-20^{\circ}\text{C}\sim 85^{\circ}\text{C}$ , 10%~90%RH (without dew point);  
(存储温度  $-20^{\circ}\text{C}\sim 85^{\circ}\text{C}$ , 湿度 10%~90%RH (无凝露));

### 2. Instruction(用法说明):


- 2-1. Turn off the power connection before installation.(安装前要切断电源).
- 2-2. Indoor use only. (仅供室内使用).
- 2-3. Load of the secondary shall not exceed the rated power.(负载不可超过额定功率).
- 2-4. Installation shall be done by qualified technician.(要有一定专业知识的人才能安装).
- 2-5. Make sure all the cables connected correctly before turn on the power.  
(接通电源前要确定所有的电线连接正确).
- 2-6. Maximum ambient temperature  $45^{\circ}\text{C}$ , 最大工作环境温度  $45^{\circ}\text{C}$

### 3. Externality figure and name plate (外形图):

#### 3-1 外形图

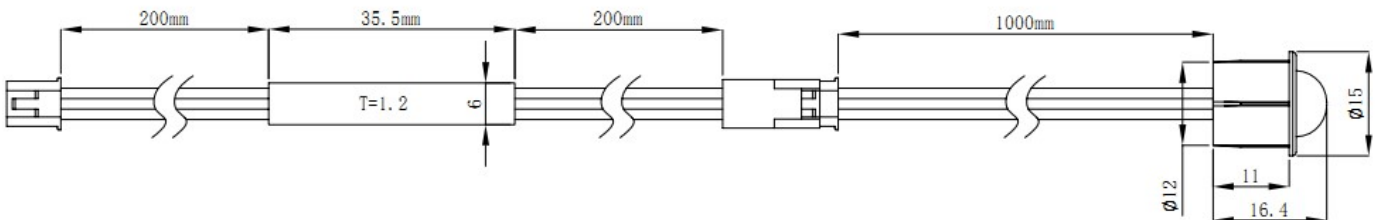

#### 3-2 感应头尺寸

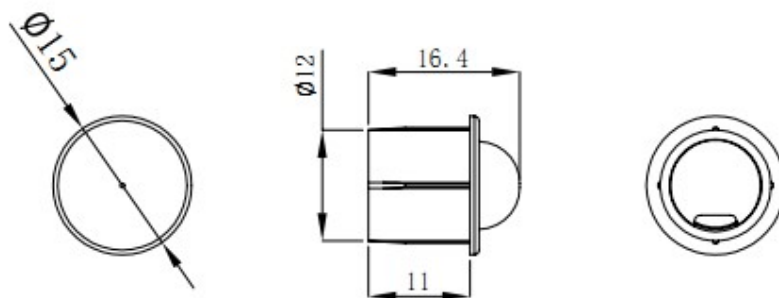

#### 4. Production test specification(生产测试规格):

序号 item	测试项目 Test items	最小值 Min	典型值 Typical value	最大值 Max	备注 Remarks
1	半成品测试,待机输入电流 Semi finished product test,standby input current	--	10mA	100mA	DC 12V input
2	半成品测试,待机输入电流 Semi finished product test,standby input current	--	10mA	100mA	DC 24V input
3	感应方式 Induction mode	人体感应 PIR SENSOR			
4	成品测试,输入电流 Finished product test, input current	--	60mA	100mA	DC 12V input
5	成品测试,输入电流 Finished product test, input current	--	60mA	100mA	DC 24V input
6	感应距离测试 distance	2.5M min			
7	时间测试 Time	30±5s (测试时间以人体离开感应区最后时间起计算) The test time is calculated from the last time when the human body leaves the sensing area			
8	感应角度测试 Induction angle test	90°			
9	寿命 Lifetime	30000H			
10	功能 Function	当在 2.5 米范围内感应到人体走动, LED 为开灯状态。当人离开感应范围后 30 秒左右, LED 灯自动熄灭。注: 开灯后, 人体仍一直在感应范围内走动熄灭时间延长。When human body movement is sensed within 2.5 meters, LED is on. The LED light will turn off automatically about 30 seconds after the person leaves the sensing range. Note: After the light is turned on, the human body still walks in the sensing range and the off time is prolonged.			输出高低电平信号 Output high and low level signals

**LETARON**<sup>®</sup>

擎洲光电科技有限公司  
**Letaron Electronic Co., LTD**

Address: Xiaotiantou Village Xinsi Area Hengli Town, Dongguan City, Guangdong Province, P.R. China

地址: 广东省东莞市横沥镇新四小田头村

Tel: +86 769 89110666 Fax: +86 769 87060909

E-Mail: [Sales@letaron-group.com](mailto:Sales@letaron-group.com) Postcode: 523460 Website: [www.letaron-group.com](http://www.letaron-group.com)

---